

30 OR 50 AMP CAMPER TRAILER SERVICE ENTRANCE REQUIREMENTS




POLE SPECIFICATIONS

1. 20 FOOT TREATED POLE; SIX INCHES IN DIAMETER.
2. POLE MUST BE SET FOUR FEET DEEP IN GROUND.
3. MUST INSTALL CONCRETE AROUND TOP TWO FEET OF HOLE.
4. WEATHERHEAD AND EXPOSED SERVICE CONDUCTORS MUST BE LOCATED AT LEAST 3 FEET FROM DOOR OR WINDOW. THE METERBASE MUST BE LOCATED AT LEAST 3 FEET FROM HINGED SIDE OF DOOR.
5. IT IS THE CUSTOMER'S RESPONSIBILITY TO PROVIDE A SERVICE POLE OF ADEQUATE STRENGTH AND STABILITY TO WITHSTAND THE STRAIN IMPOSED BY THE UTILITY'S SERVICE DROP.

CUSTOMER'S SERVICE ENTRANCE

TWO-#6 BLACK HOT LEGS
ONE-#6 WHITE NEUTRAL
ALL CONDUCTORS MUST BE COPPER
DRIP LOOP MUST BE 18 INCHES OUTSIDE WEATHERHEAD
ALL WIRES MUST BE OF THE CORRECT COLORS, NOT TAPED OR PAINTED

30 OR 50 AMP DISCONNECTING MEANS CONSISTING OF A CIRCUIT BREAKER, OR A SWITCH AND FUSE, AND ITS ACCESSORIES INSTALLED IN A READILY ACCESSIBLE LOCATION NEAR THE POINT OF ENTRANCE OF THE SUPPLY CORD.

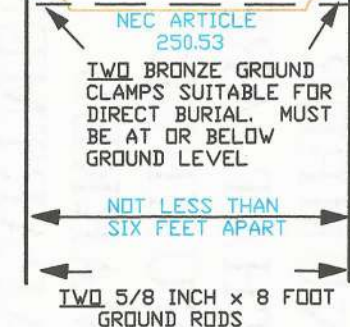

ALL SERVICES SHALL MEET OR EXCEED THE NEC AND NESC CODES


SEE BACK FOR OTHER INSTRUCTIONS

THE POWER SUPPLY CORD SHALL BE A LISTED TYPE WITH FOUR CONDUCTORS FOR 240VAC APPLICATIONS, THREE CONDUCTORS FOR 110VAC APPLICATIONS AND ONE SHALL BE IDENTIFIED BY A CONTINUOUS GREEN COLOR. THE GREEN COLORED INSULATED GROUNDING WIRE IN THE SUPPLY CORD SHALL BE CONNECTED TO THE GROUNDING BUS IN THE DISTRIBUTION PANELBOARD AND DISCONNECTING MEANS, ONE BEING A PERMANENT COLOR OF WHITE FOR THE GROUNDED CONDUCTOR.

THE POWER SUPPLY PLUG SHALL BE LISTED, BY ITSELF OR AS PART OF THE POWER-SUPPLY CORD ASSEMBLY, FOR THE PURPOSE AND SHALL BE MOLDED TO OR INSTALLED ON THE FLEXIBLE CORD SO THAT IT IS SECURED TIGHTLY TO THE CORD AT THE POINT WHERE THE CORD ENTERS THE ATTACHMENT PLUG CAP.

THE CORD-EXPOSED USABLE LENGTH SHALL NOT EXCEED 36 FEET.

REVISED DECEMBER 2016
PONTOTOC ELECTRIC POWER ASSOCIATION
662-489-3211 PONTOTOC
662-983-2727 BRUCE R. MORGAN

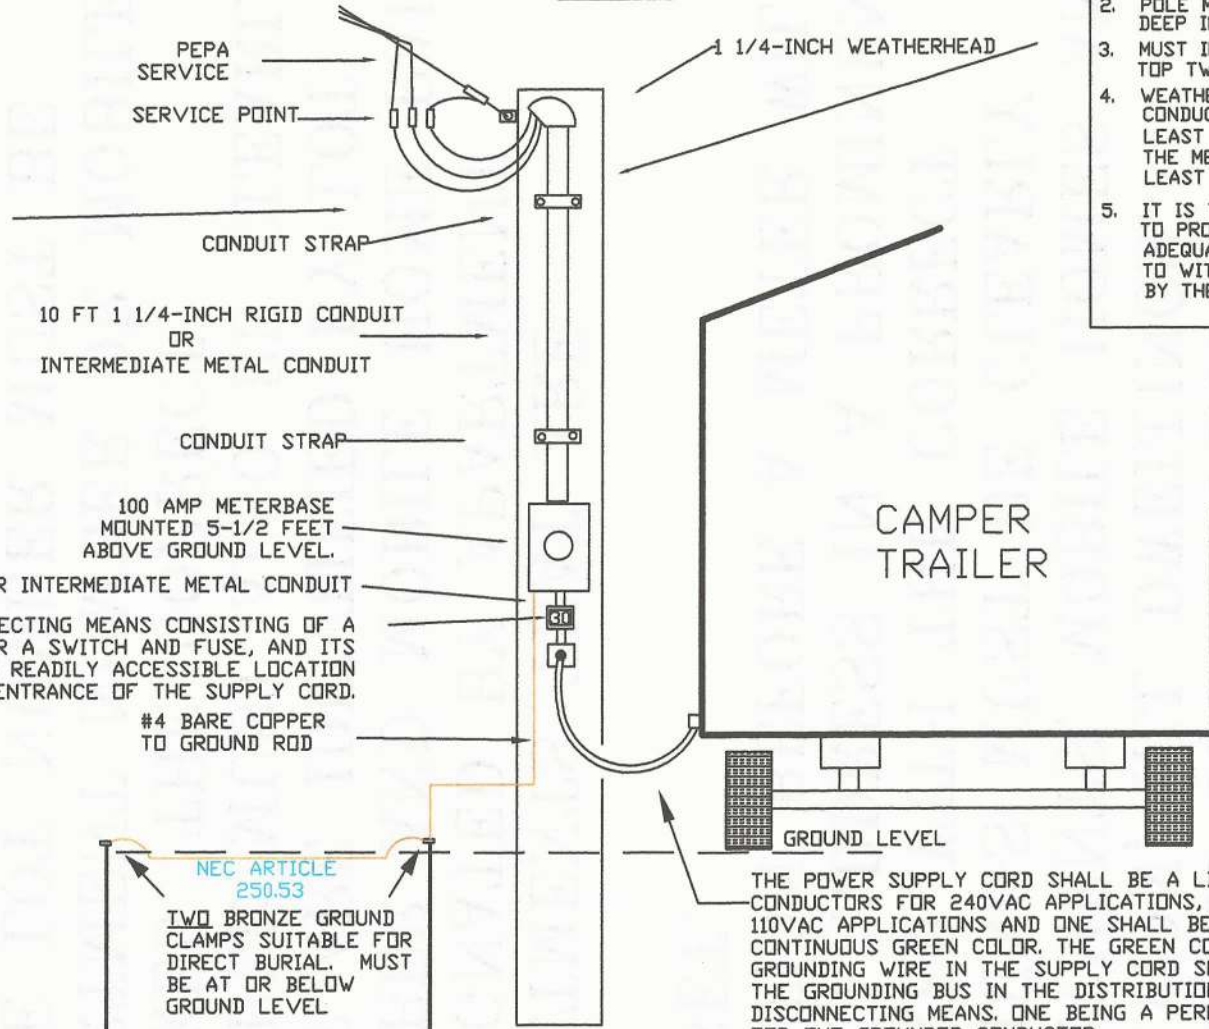

IN ORDER TO INSURE THAT THE METER IS SET AT PROPER LOCATION, ALL DWELLINGS, APARTMENTS, MOBILE HOMES AND BUILDINGS MUST BE CLEARLY MARKED WITH THE CORRECT E-911 ADDRESS IN A PROMINENT LOCATION BEFORE A METER WILL BE SET.

APARTMENTS THAT ARE DESIGNATED BY APARTMENT NUMBER AND MOBILE HOME PARKS THAT ARE IDENTIFIED BY LOT NUMBER MUST ALSO BE CLEARLY MARKED. THE CORRECT APARTMENT NUMBER OR MOBILE HOME LOT NUMBER MUST BE SHOWN ON THE RENTAL RECEIPT.