

400 AMP UNDERGROUND RESIDENTIAL HOME SERVICE ENTRANCE REQUIREMENTS

RESIDENTIAL HOME REQUIREMENTS

1. A PERMANENT DWELLING STRUCTURE EITHER ON CONCRETE BLOCKS OR ON CONCRETE SLAB.
2. STRUCTURE MUST BE A NON-COMMERCIAL UNIT FOR A SINGLE FAMILY DWELLING.
3. NO WHEELS OR AXLES THAT CAN MAKE THE STRUCTURE MOBILE.




ELECTRICAL SERVICE ENTRANCE SPECIFICATIONS

CUSTOMER IS RESPONSIBLE FOR INSTALLING METERBASE, RIGID OR INTERMEDIATE METAL CONDUIT TO JUST BELOW GROUND LEVEL, COUPLING AND 90 DEGREE SCHEDULE 40 GRAY ELECTRICAL PVC CONDUIT.

CUSTOMER IS RESPONSIBLE FOR INSTALLING CONDUIT IN A PLUMB OR LEVEL MANNER WHICH MAY REQUIRE THE HOUSE FOOTING TO BE MODIFIED.

ALL CONDUCTORS ENTERING THE HOUSE MUST BE THE CORRECT SIZE AND COPPER.

THE METERBASE MUST BE LOCATED AT LEAST 3 FEET FROM HINGED SIDE OF DOOR.

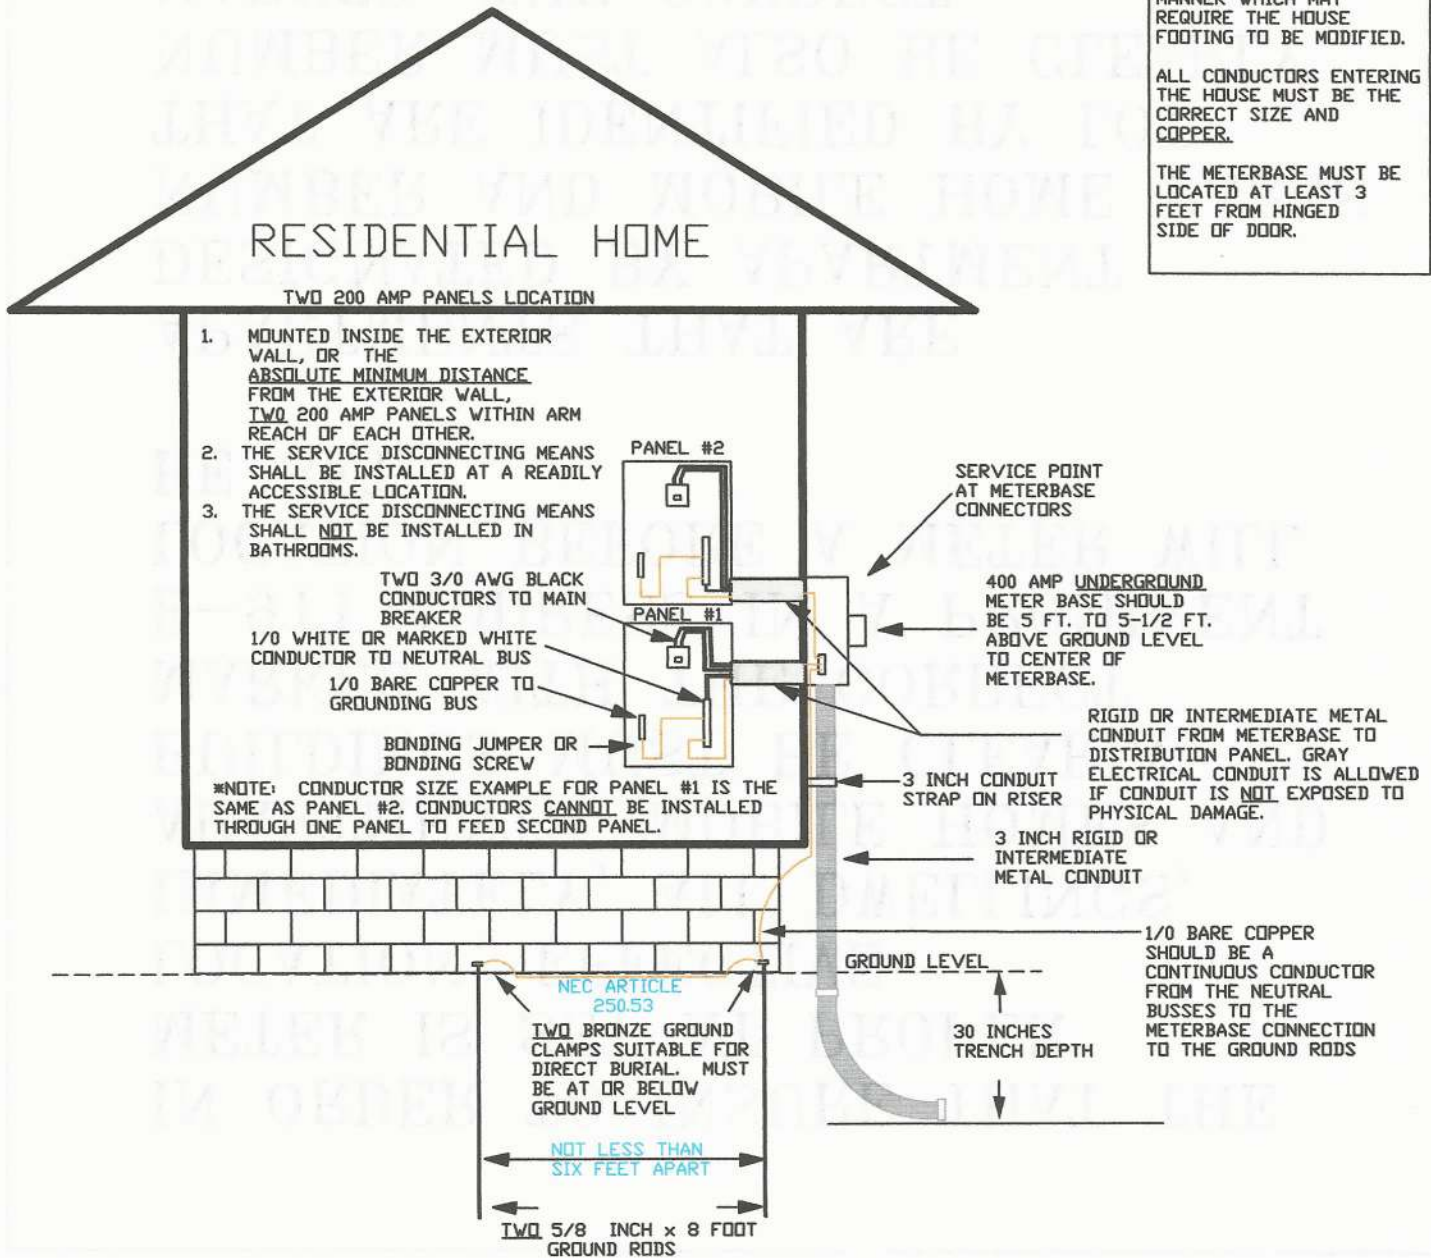

ALL SERVICES SHALL MEET OR EXCEED THE NEC AND NESC CODES

SEE BACK FOR OTHER INSTRUCTIONS

REVISED DECEMBER 2016

PONTOTOC ELECTRIC POWER ASSOCIATION
 662-489-3211 PONTOTOC
 662-983-2727 BRUCE
 DRAWN BY R. MORGAN

IN ORDER TO INSURE THAT THE METER IS SET AT PROPER LOCATION, EFFECTIVE IMMEDIATELY, ALL DWELLINGS, APARTMENTS, MOBILE HOMES AND BUILDINGS MUST BE CLEARLY MARKED WITH THE CORRECT E-911 ADDRESS IN A PROMINENT LOCATION BEFORE A METER WILL BE SET.

APARTMENTS THAT ARE DESIGNATED BY APARTMENT NUMBER AND MOBILE HOME PARKS THAT ARE IDENTIFIED BY LOT NUMBER MUST ALSO BE CLEARLY MARKED. THE CORRECT APARTMENT NUMBER OR MOBILE HOME LOT NUMBER MUST BE SHOWN ON THE RENTAL RECEIPT.